


A = 125mm: Outer Diameter HDPE ESB Approved Duct, SDR=17.6
 B= 160mm : Outer Diameter HDPE ESB Approved Duct, SDR= 21
 C = 63mm: ECC Earth Continuity Conductor

Typical Section through Off Road Section

SCALE 1:10

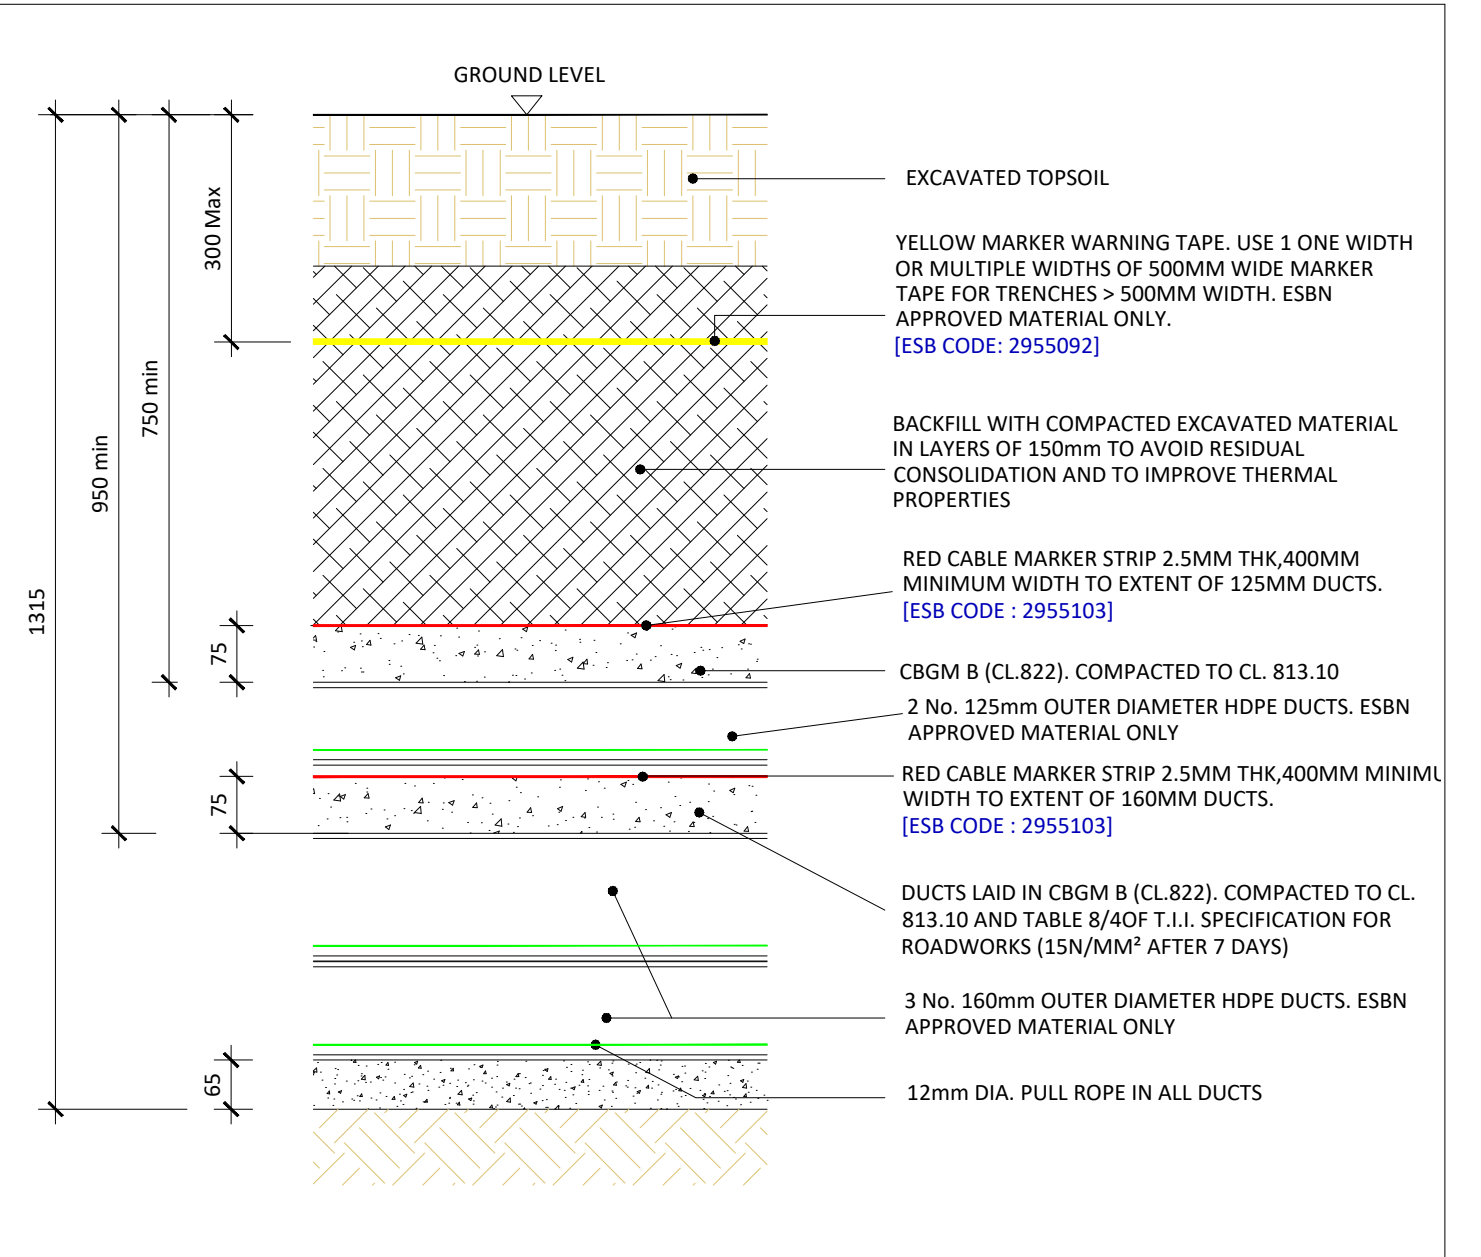

Typical Elevation through Off Road Section

SCALE 1:10

Note:

- This drawing is to be read in conjunction with relevant drawings, specifications and reports
- Dimensions are in millimeters, unless noted otherwise
- Drawings are not to be scaled use figured dimensions only

ALL REINSTATEMENT WORKS ARE TO BE IN ACCORDANCE WITH LANDOWNER REQUIREMENTS



Head Office
 Beenreigh,
 Abbeydorney,
 Tralee, Co. Kerry
 Ireland
 Tel: 00353 66 7135710

CLIENT



PROJECT

Clondardis 110kV

Substation

PROJECT NUMBER
 05-916

SHEET NUMBER
 05916-DR-208

SHEET TITLE

Typical Ducting through Off Road
 Sections - Section and Elevation

DRAWING STATUS
 For SID Planning

ISSUE/REVISION

I/R	DATE	DESCRIPTION
P02	06.03.23	For SID Planning
P01	21.12.22	For SID Planning
P00	08.09.22	For Pre-SID Planning